

2" R W/ C.I. PLUG FOR INSPECTION OPENING (2) PLC'S.

3" W/ BAFFLE STENCIL "INLET"

3"-150# R.F.S.O. FLG. W/ SCH. 40 PIPE x 7" LG. (2) PLC'S.

1/2" Ø L.LUG (2) PLC'S.

RAISED N.PL.


(3) 2 1/2" x 2 1/2" x 1/4" THK. x 22 1/16" LG. ANGLE LEGS

(3) 4" x 4" x 3/8" THK. PAD W/ 3/4" Ø HOLE FOR 1/2" Ø x 8" LG. BOLTS GRADE 5 OR BETTER 6" EMBEDMENT

NOTE: 1) HYDRO @ 164 PSIG. MIN.

SHELL / HEADS	
JOGGLE	.166" SA-414-G 2:1 S.E.
	.165" SA-414-G
M.A.W.P.	125 PSIG. @ 200 °F
M.D.M.T.	-20 °F @ 125 PSIG.
ASME SECTION VIII	DIV. 1, 2007 ADD 2007
X-RAY:	RT-NO
GALLONS:	235 WT. 479 LBS.
SERIAL NO.	
N.B.	

WM-146-B	
FOR: -	REV. DATE: 12-11-07
VERT. WATER (BUFFER) TANK	
SURFACE AREA = 58.6 SQ. FT.	
INSIDE: UNPAINTED	
OUTSIDE: PRIME	
LEG-ZONE 4-5 KM.	
BY: E.S. / H.D. SCALE: 1" = 12"	
ROY E. HANSON JR. MFG.	
1600 E. WASHINGTON BLVD.	
LOS ANGELES, CA 90021	

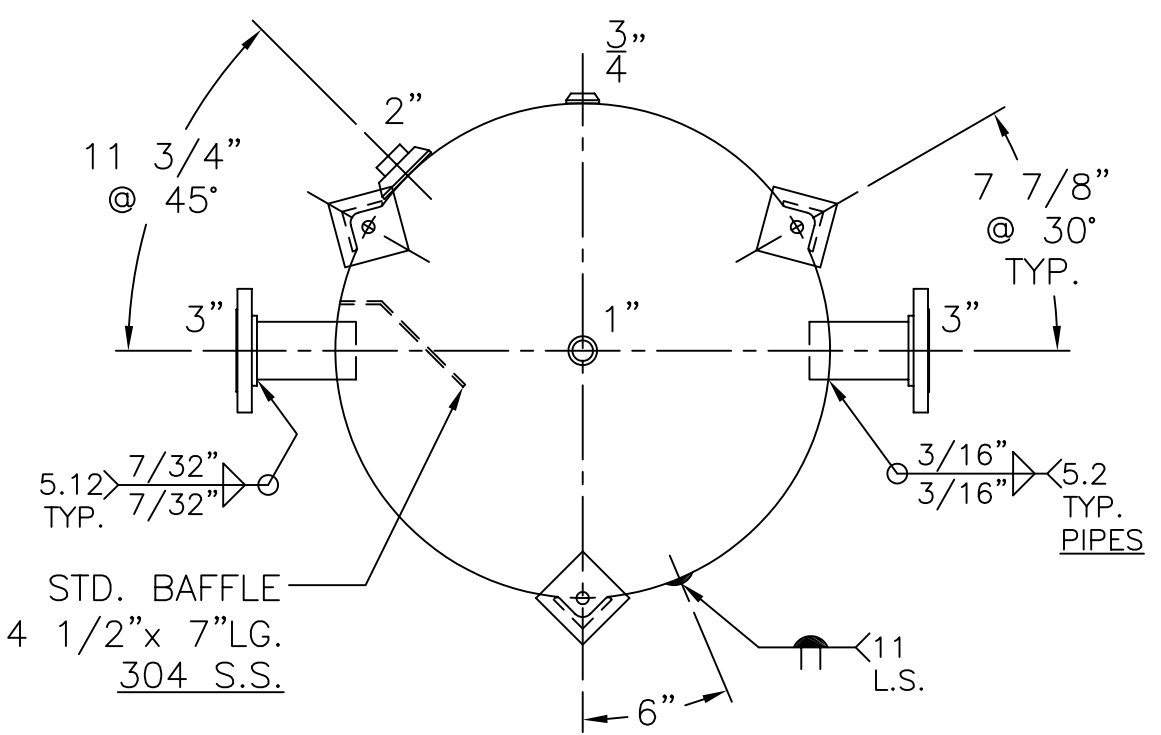

STD. BAFFLE 4 1/2" x 7" LG. 304 S.S.