DATE	BY

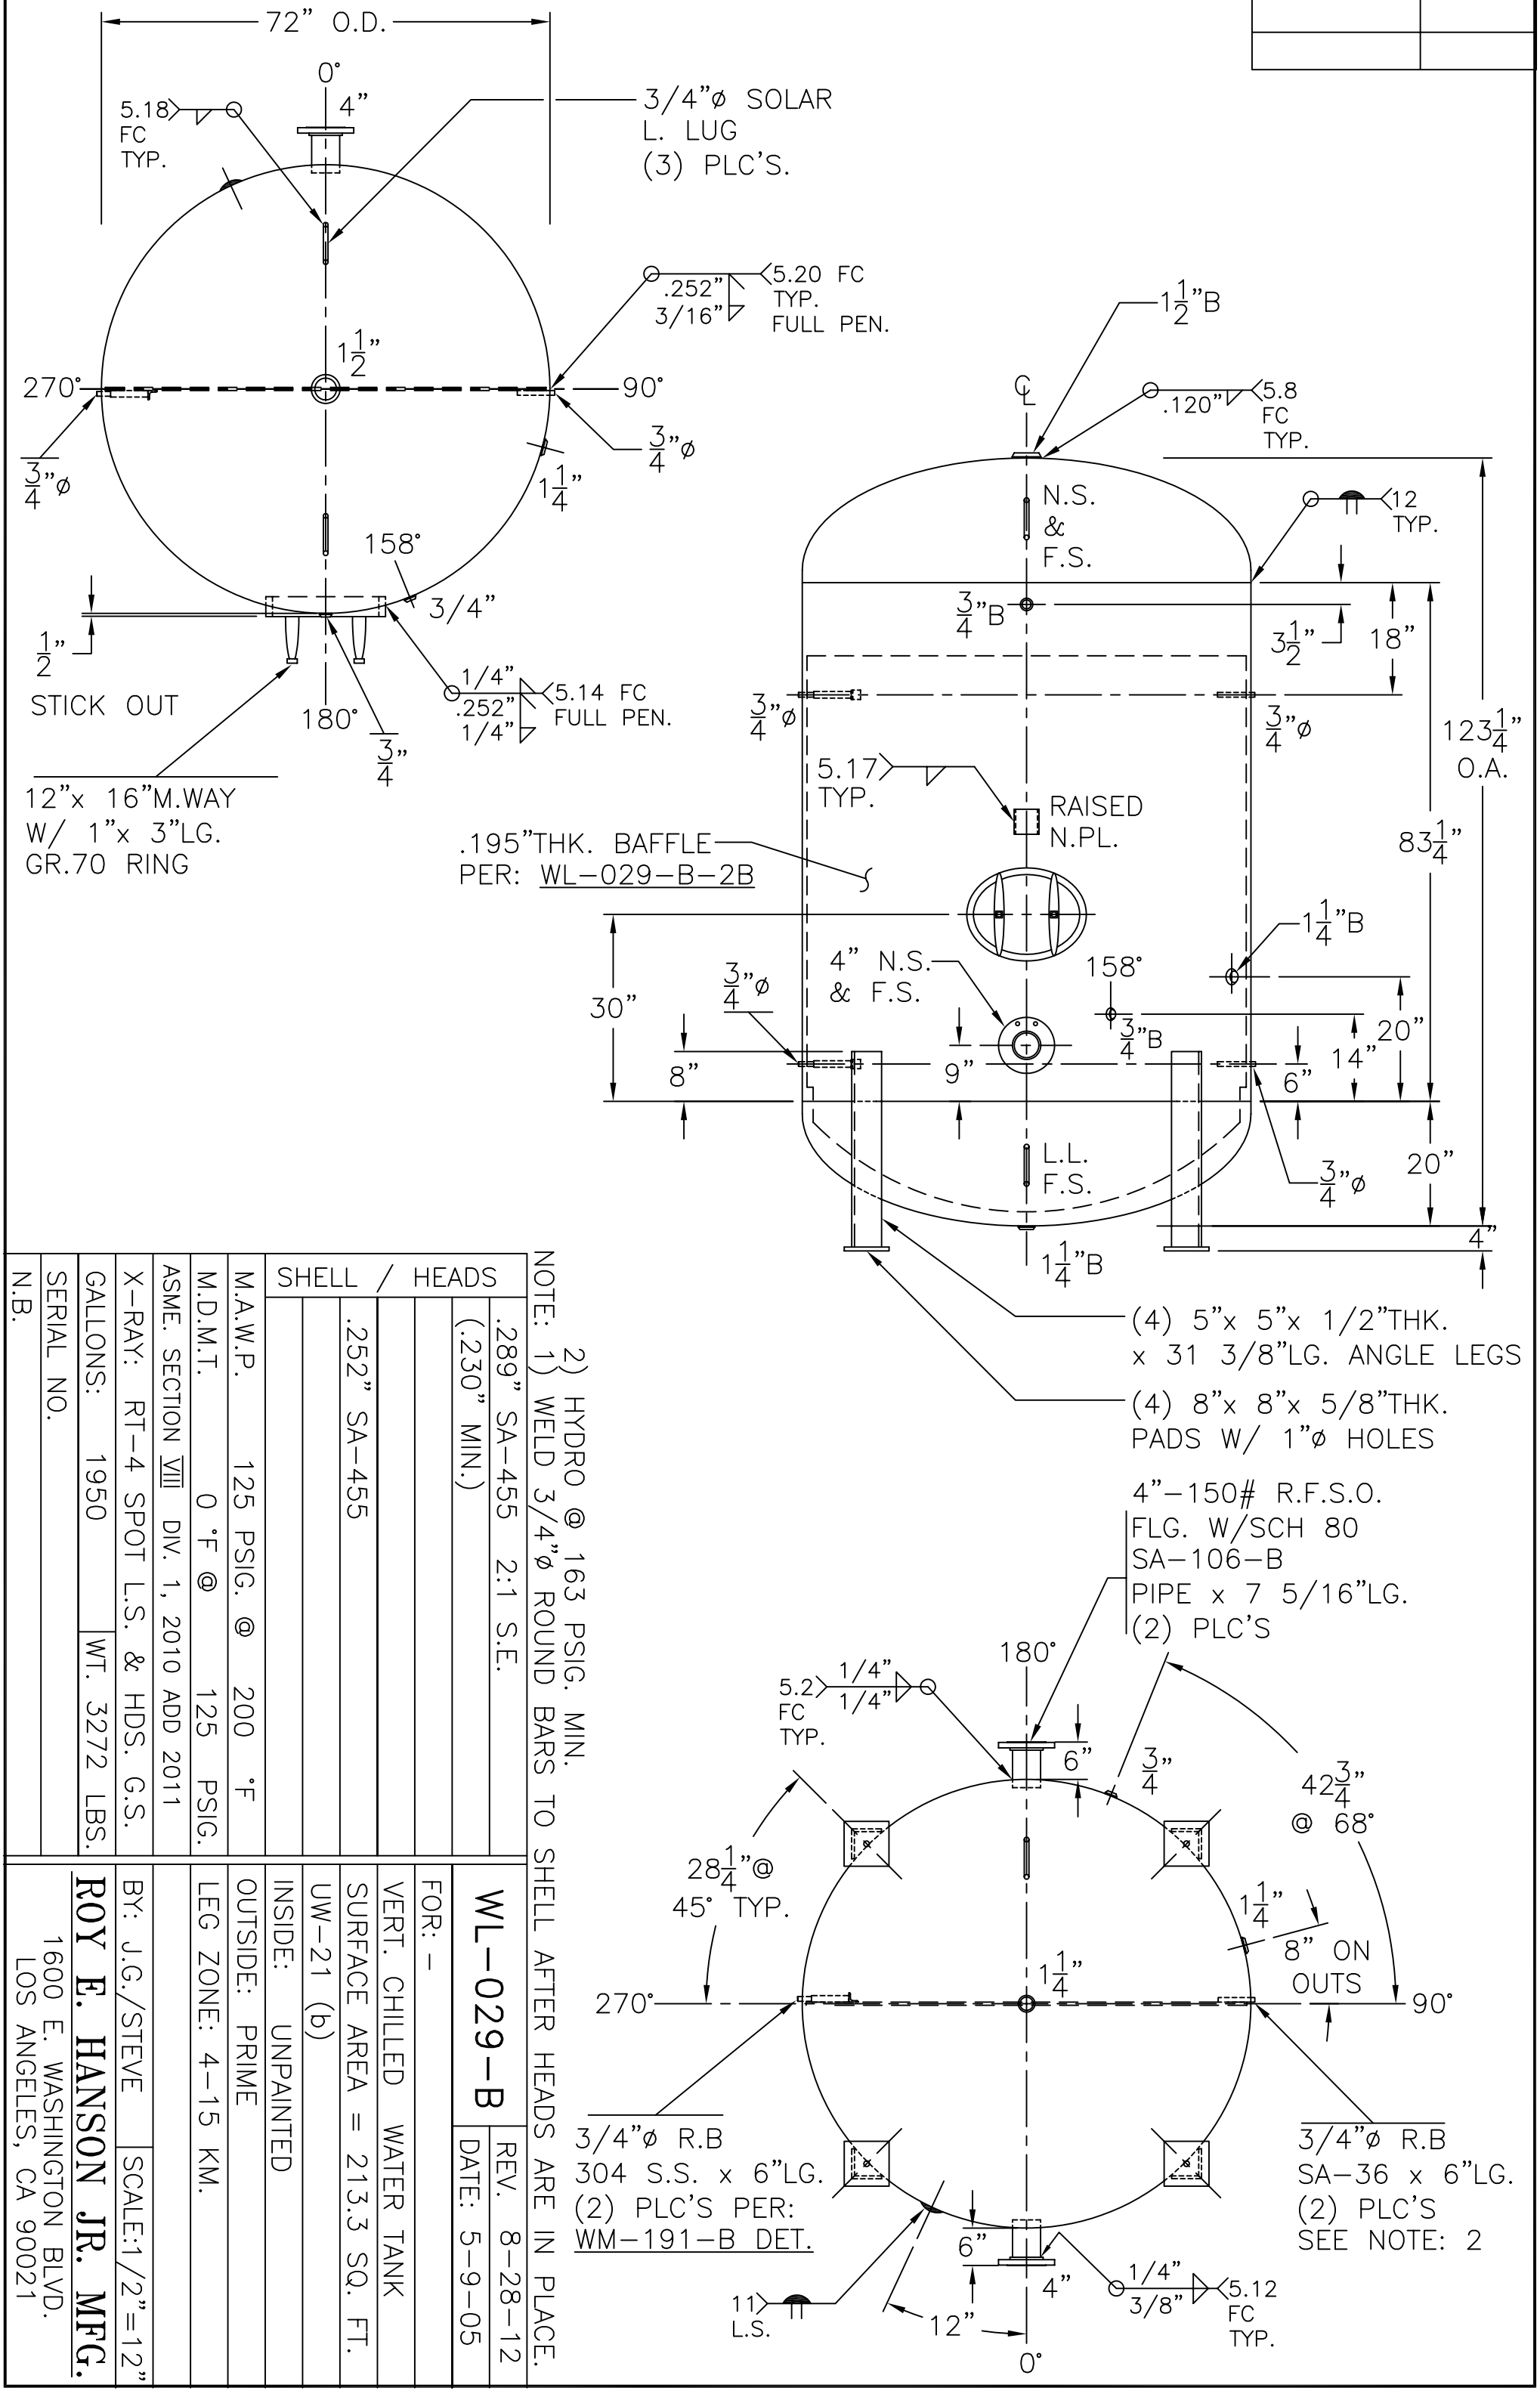

NOTE: 1) WELD 3/4"ø ROUND BARS TO SHELL AFTER HEADS ARE IN PLACE.
2) HYDRO @ 163 PSIG. MIN.

SHELL / HEADS	
M.A.W.P.	125 PSIG. @ 200 °F
M.D.M.T.	0 °F @ 125 PSIG.
ASME. SECTION VIII DIV. 1, 2010 ADD 2011	
X-RAY: RT-4 SPOT L.S. & HDS. G.S.	
GALLONS: 1950	WT. 3272 LBS.
SERIAL NO.	
N.B.	

.289" SA-455 2:1 S.E.	
(.230" MIN.)	
.252" SA-455	

FOR: -

VERT. CHILLED WATER TANK

SURFACE AREA = 213.3 SQ. FT.

UW-21 (b)

INSIDE: UNPAINTED

OUTSIDE: PRIME

LEG ZONE: 4-15 KM.

WL-029-B	REV. 8-28-12
	DATE: 5-9-05
BY: J.G./STEVE	SCALE:1/2"=12"

ROY E. HANSON JR. MFG.

1600 E. WASHINGTON BLVD.
LOS ANGELES, CA 90021