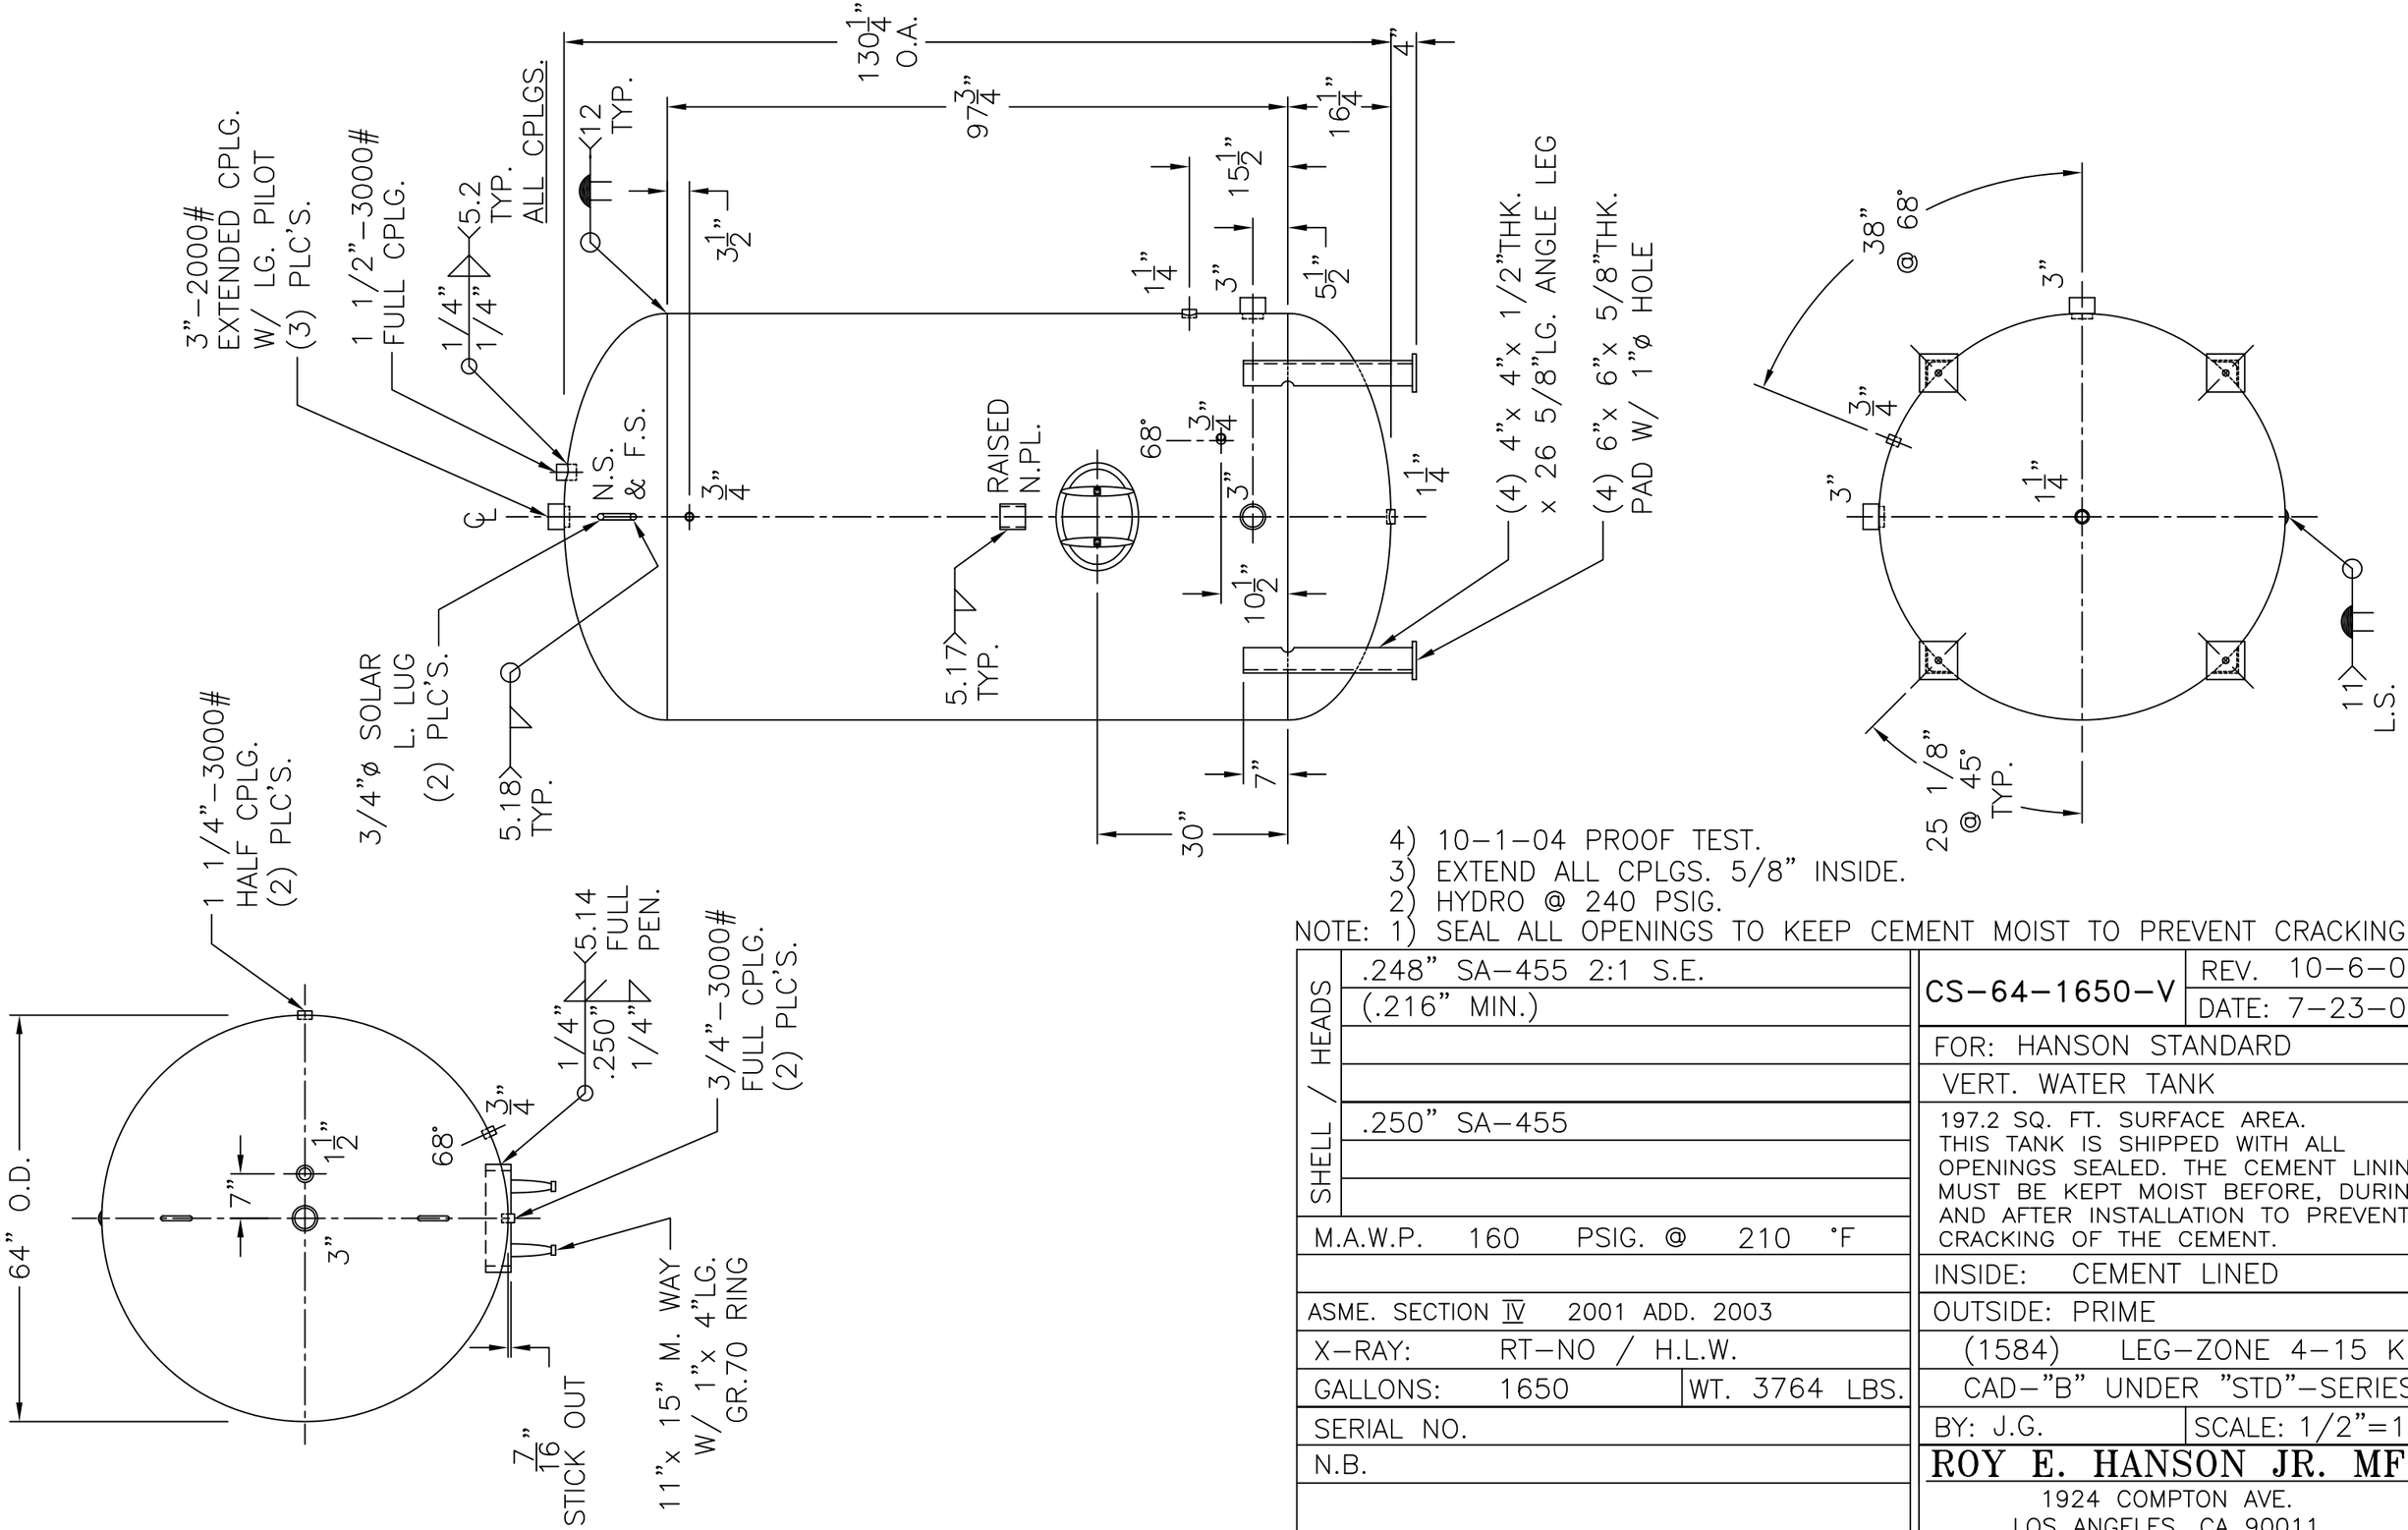


NOTE: 1) SEAL ALL OPENINGS TO KEEP CEMENT MOIST TO PREVENT CRACKING.
2) HYDRO @ 240 PSIG.
3) EXTEND ALL CPLGS. 5/8" INSIDE.
4) 10-1-04 PROOF TEST.

| | |
|---|---|
| SHELL / HEADS | .248" SA-455 2:1 S.E. |
| | (.216" MIN.) |
| | |
| | |
| | .250" SA-455 |
| | |
| | |
| M.A.W.P. 160 PSIG. @ 210 °F | |
| | |
| ASME. SECTION IV 2001 ADD. 2003 | |
| X-RAY: RT-NO / H.L.W. | |
| GALLONS: 1650 | WT. 3764 LBS. |
| SERIAL NO. | |
| N.B. | |

| | |
|---|---|
| CS-64-1650-V | REV. 10-6-04 |
| | DATE: 7-23-01 |
| FOR: HANSON STANDARD | |
| VERT. WATER TANK | |
| 197.2 SQ. FT. SURFACE AREA. THIS TANK IS SHIPPED WITH ALL OPENINGS SEALED. THE CEMENT LINING MUST BE KEPT MOIST BEFORE, DURING, AND AFTER INSTALLATION TO PREVENT CRACKING OF THE CEMENT. | |
| INSIDE: CEMENT LINED | |
| OUTSIDE: PRIME | |
| (1584) LEG-ZONE 4-15 KM. | |
| CAD-"B" UNDER "STD"-SERIES | |
| BY: J.G. | SCALE: 1/2"=12" |

**ROY E. HANSON JR. MFG.**
1924 COMPTON AVE.
LOS ANGELES, CA 90011