DATE	BY
6-19-14	RH

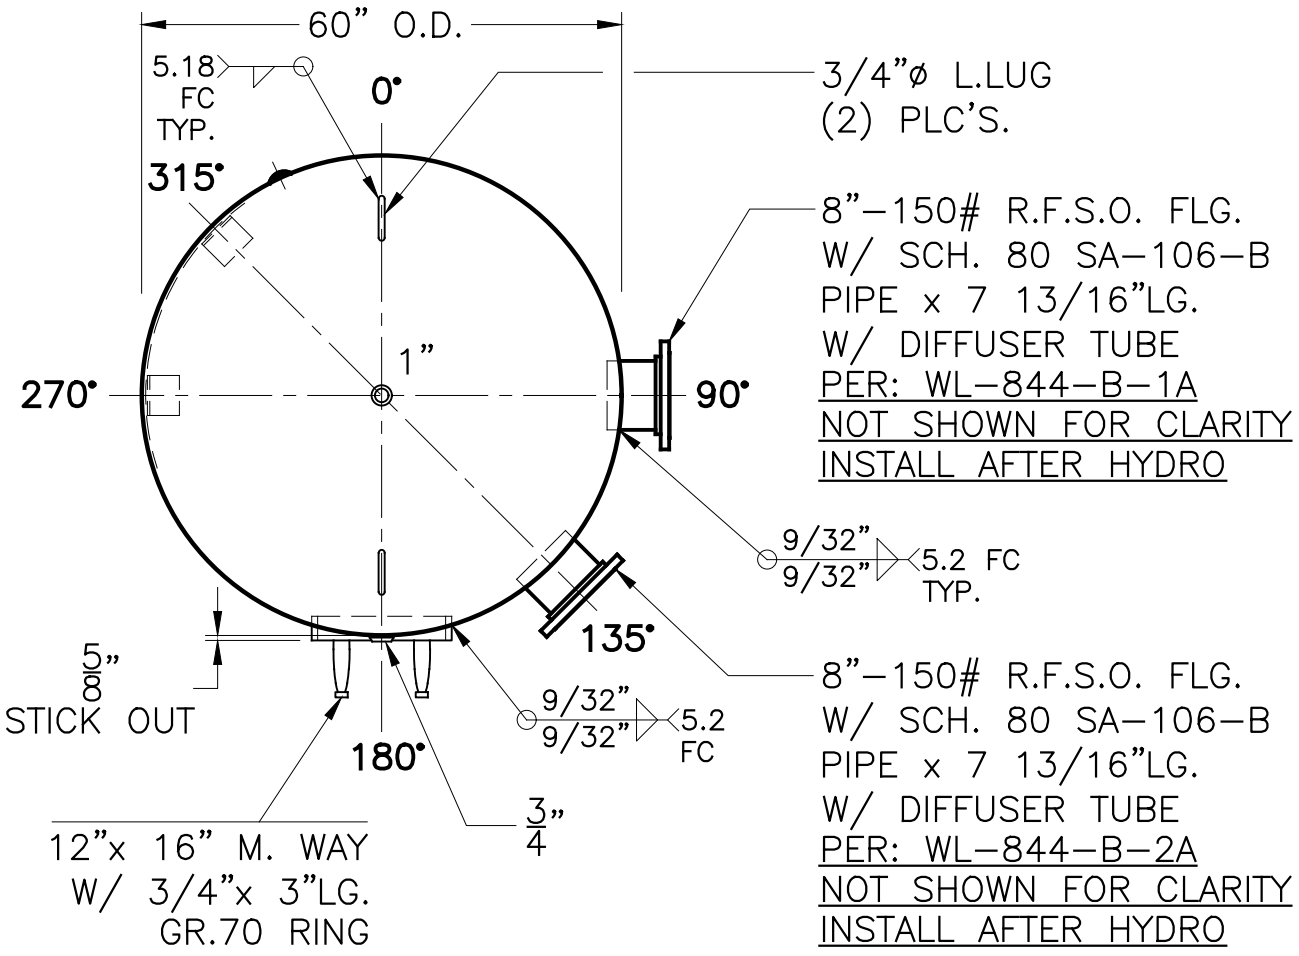

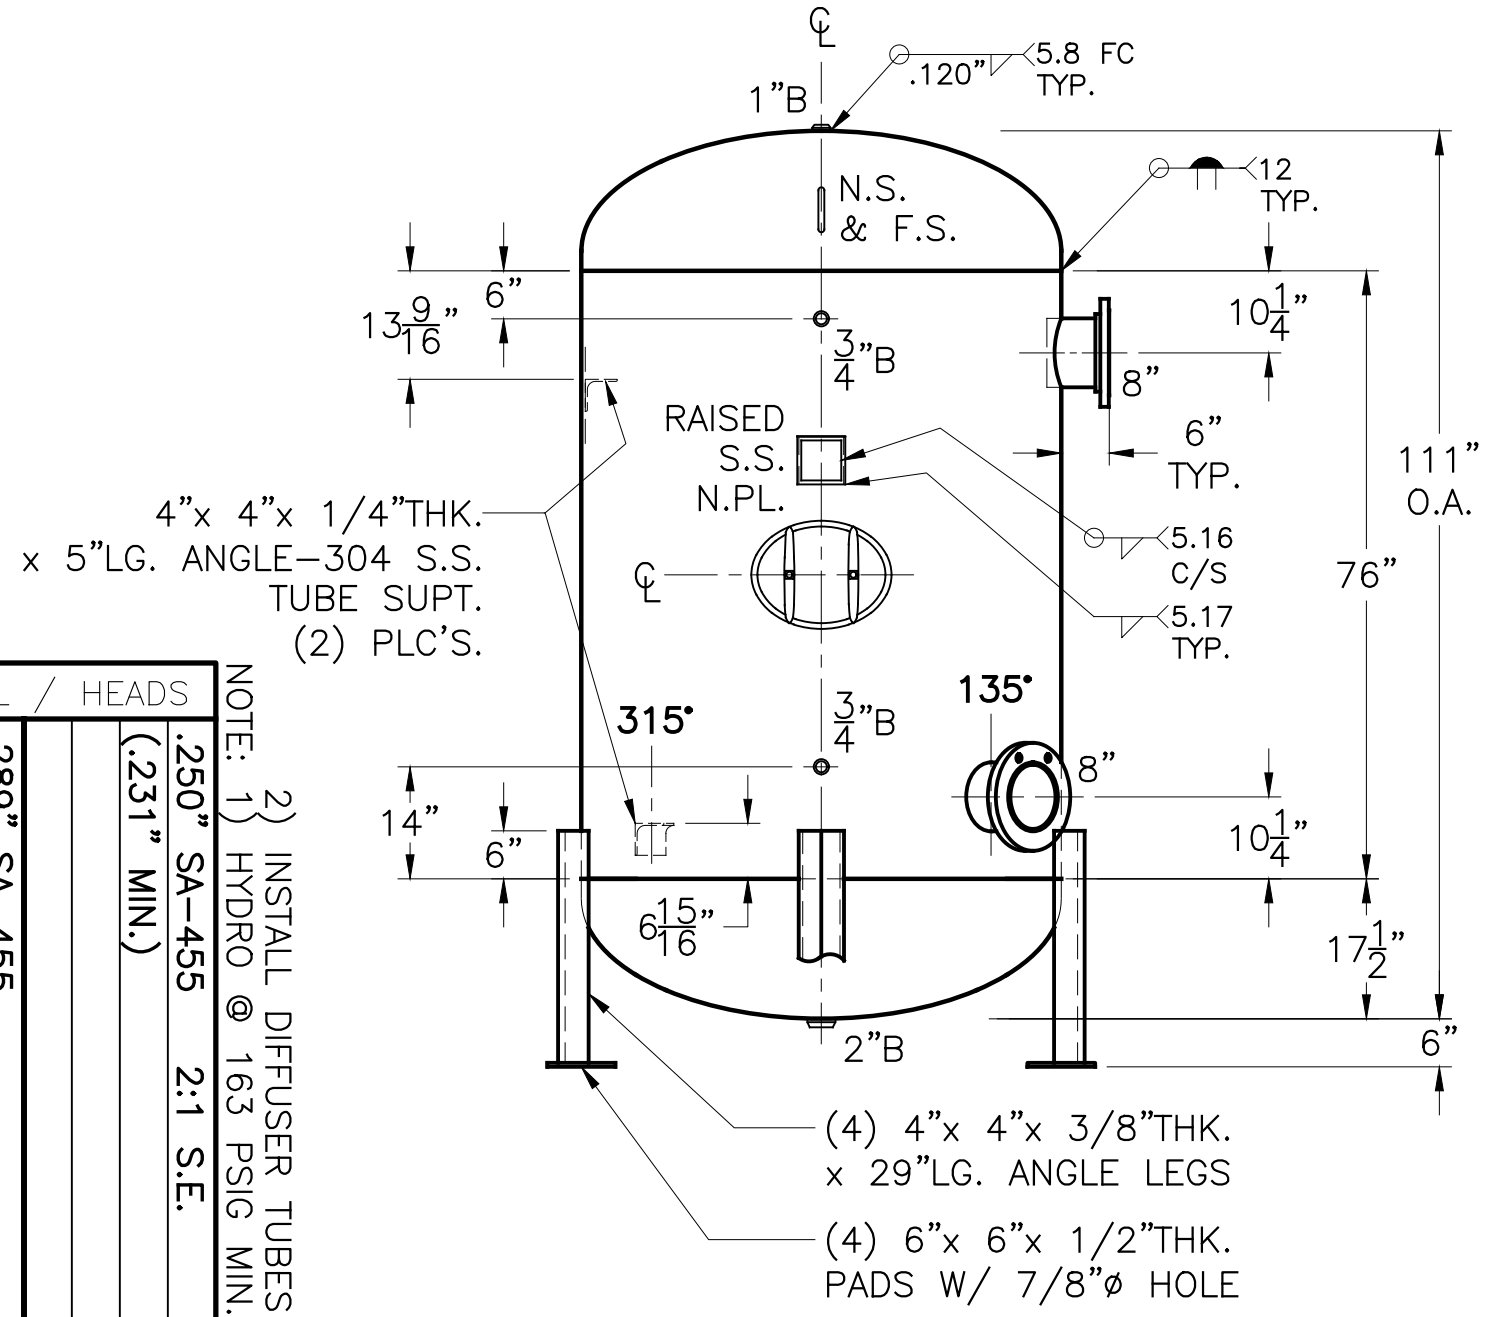

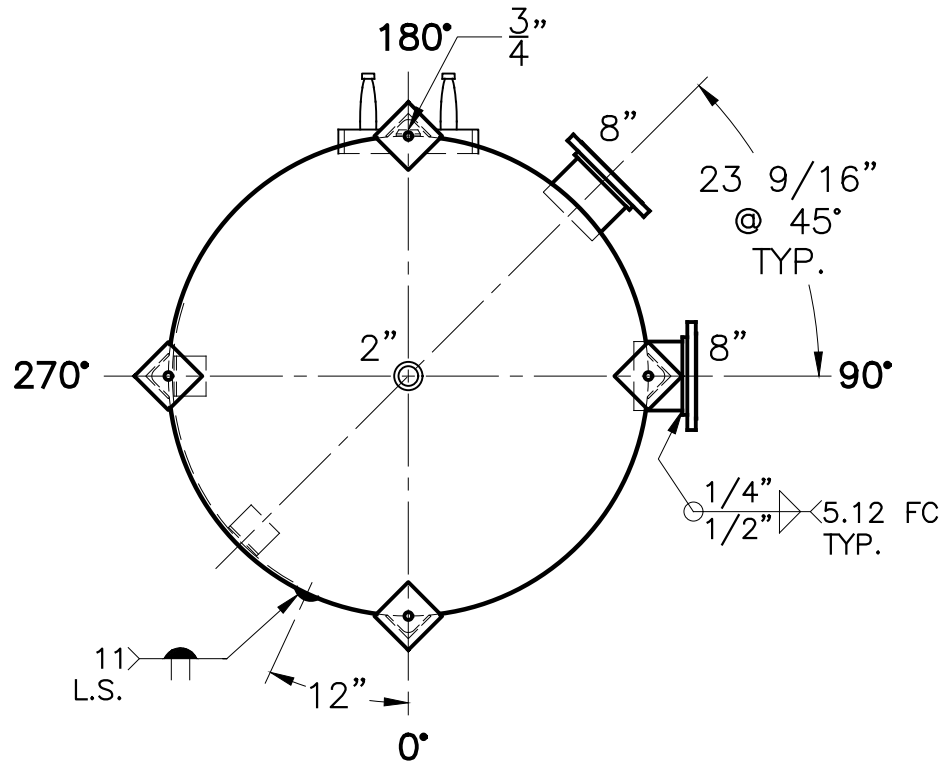

NOTE: 1) HYDRO @ 163 PSIG MIN. 2) INSTALL DIFFUSER TUBES AFTER HYDRO.

SHELL / HEADS	
M.A.W.P. 125 PSIG. @ 200 °F	.250" SA-455 2:1 S.E.
M.D.M.T. 0 °F @ 125 PSIG.	(.231" MIN.)
ASME. SECTION VIII DIV. 1, 2013	
X-RAY: RT-NO	.289" SA-455
GALLONS: 1200	
SERIAL NO.	
N.B.	WT. 2612 LBS.

WL-844-B

REV. 6-18-14

DATE: 3-1-07

FOR:

VERT. CHILLED WATER TANK

SURFACE AREA = 159.6 SQ. FT.

UW-21(b)

INSIDE: UNPAINTED

OUTSIDE: PRIME

LEG-ZONE 4-15 KM.

BY: E.S. / R.V. SCALE: 1/2"=12"

ROY E. HANSON JR. MFG.
1600 E. WASHINGTON BLVD.
LOS ANGELES, CA 90031