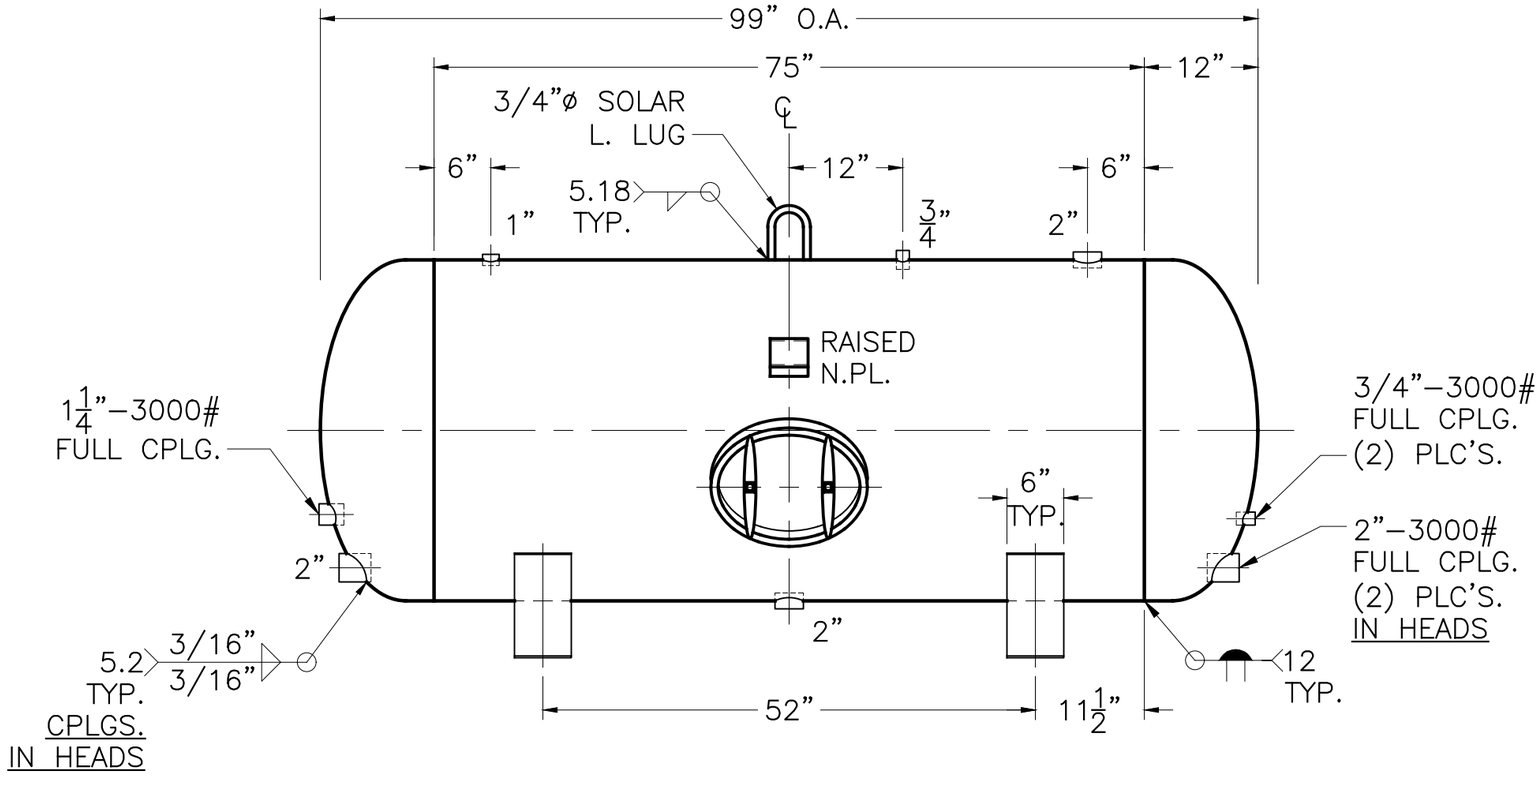

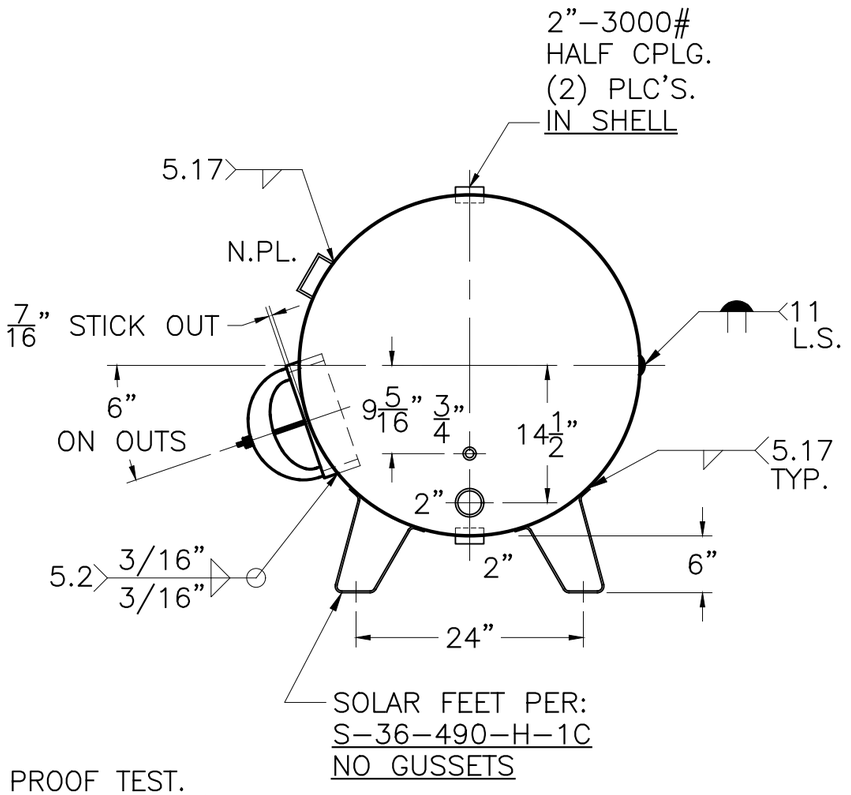

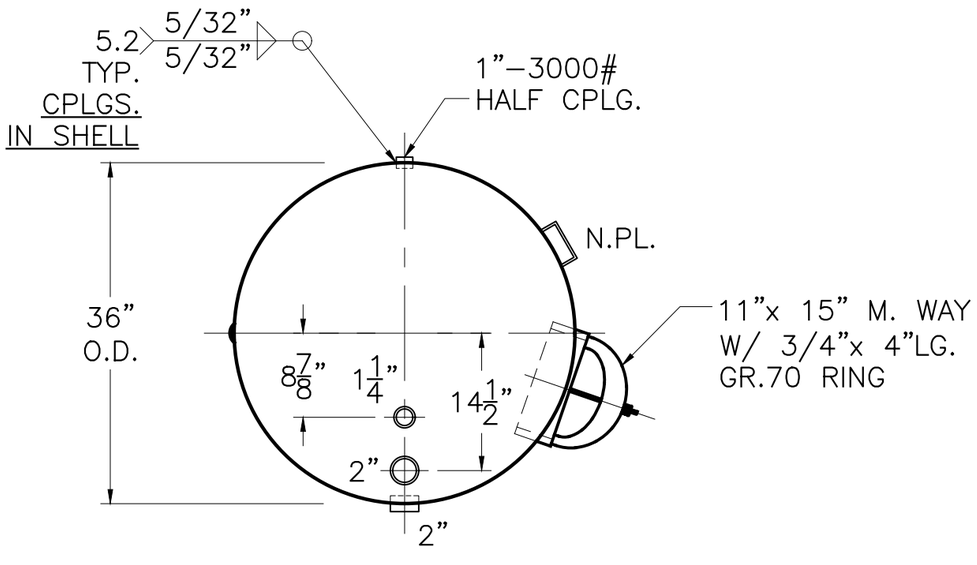

END VIEW W/OUT SUPPORTS

4) 4–1–04 PROOF TEST.
3) EXTEND ALL CPLGS. 5/8" INSIDE.
2) HYDRO @ 240 PSIG. MIN.
NOTE: 1) SEAL ALL OPENINGS TO KEEP CEMENT MOIST TO PREVENT CRACKING.

SHELL / HEADS	.182" SA–455 2:1 S.E.
	JOGGLE
	.164" SA–414–G
M.A.W.P. 160 PSIG. @ 210 °F	
ASME SECTION Ⅷ 2001 ADD. 2003	
X–RAY: RT–NO/H.L.W.	
GALLONS: 400	WT. 1332 LBS.
SERIAL NO.	

CS–36–400–H REV. 9–15–04 DATE: 5–20–94

FOR: HANSON STANDARD
HORIZ. HOT WATER TANK

82.2 SQ. FT. SURFACE AREA.
THIS TANK IS SHIPPED WITH ALL OPENINGS SEALED. THE CEMENT LINING MUST BE KEPT MOIST BEFORE, DURING, AND AFTER INSTALLATION TO PREVENT CRACKING OF THE CEMENT.

INSIDE: CEMENT LINED (378)
OUTSIDE: PRIME
CAD–"B" UNDER "STD"–SERIES
BY: E.S. SCALE: 3/4"=12"

ROY E. HANSON JR. MFG.
1924 COMPTON AVE.
LOS ANGELES, CA 90011