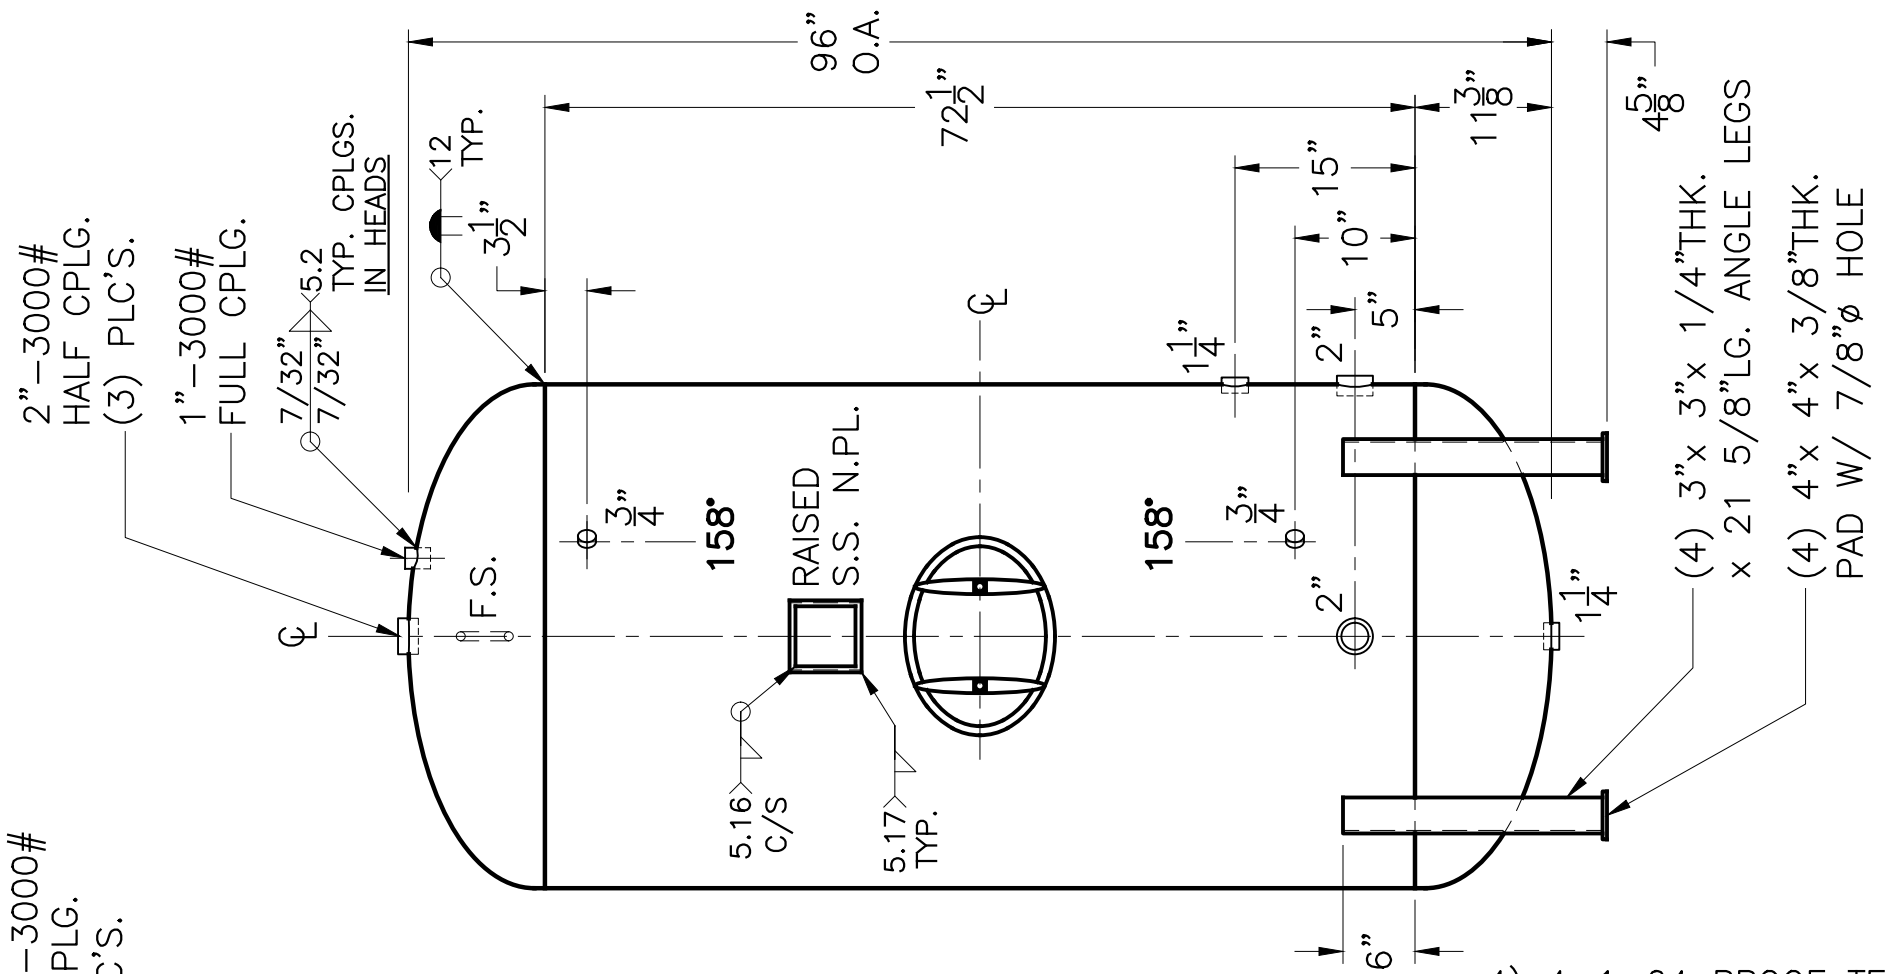

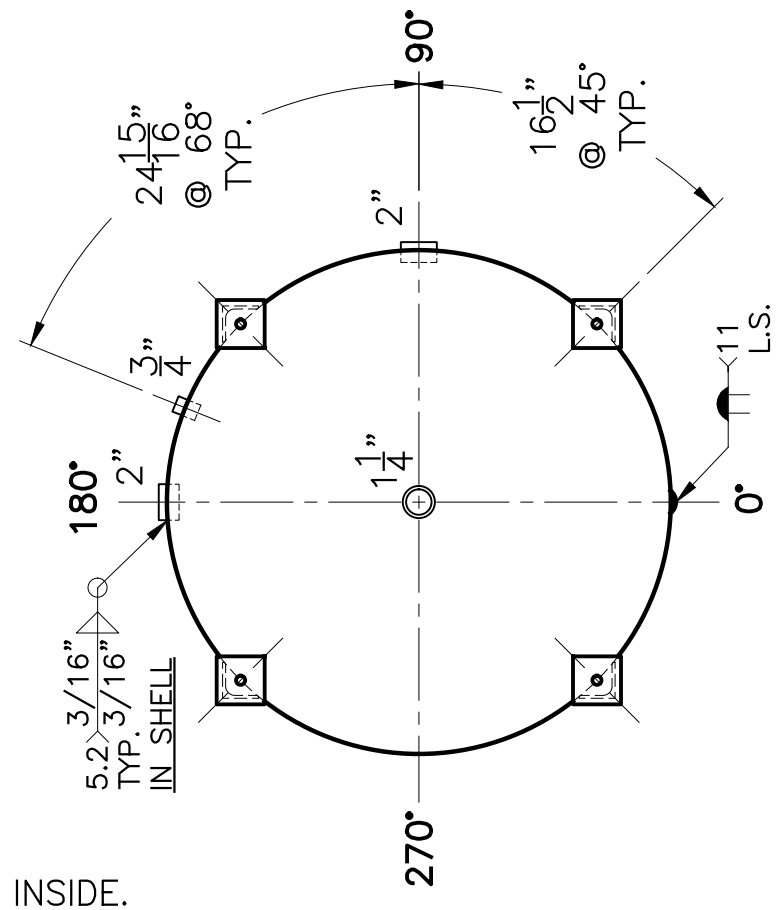

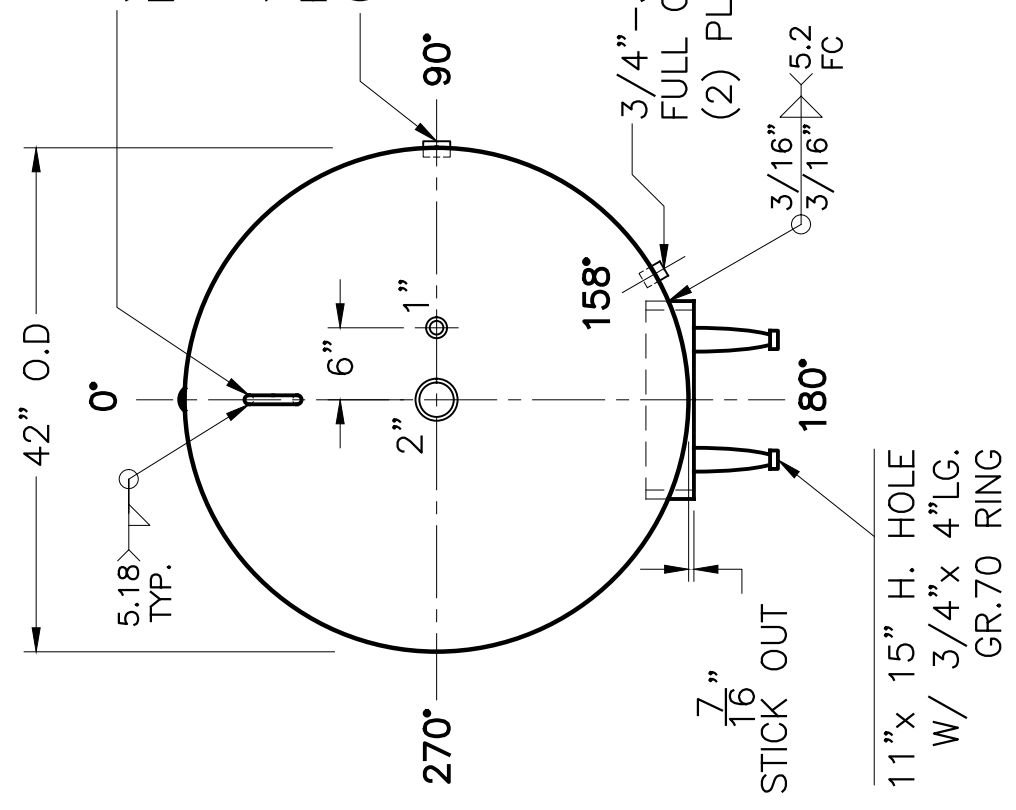

4) 4–1–04 PROOF TEST.
3) EXTEND ALL CPLG'S 5/8" INSIDE.
2) HYDRO @ 240 PSIG.
NOTE. 1) SEAL ALL OPENINGS TO KEEP CEMENT MOIST TO PREVENT CRACKING.

SHELL / HEADS	.205" SA–455 2:1 S.E.
	JOGGLE
	.175" SA–414–G
M.A.W.P. 160 PSIG. @ 210 °F	
ASME. SECTION Ⅳ 2013	
X–RAY: RT–NO / H.L.W.	
GALLONS: 534	WT. 1328 LBS.
SERIAL NO.	
N.B.	

CS–42–534–V REV. 4–4–14 DATE: 5–29–96

FOR: HANSON STANDARD VERT. HOT WATER TANK

94.4 SQ. FT. SURFACE AREA.

THIS TANK IS SHIPPED WITH ALL OPENINGS SEALED. THE CEMENT LINING MUST BE KEPT MOIST BEFORE, DURING, AND AFTER INSTALLATION TO PREVENT CRACKING OF THE CEMENT.

INSIDE: CEMENT LINED

OUTSIDE: PRIME

(498) LEG–ZONE 4–15 KM.

CAD "B" UNDER "STD"–SERIES

BY: E.S. SCALE: 3/4"=12"

ROY E. HANSON JR. MFG.
1600 E. WASHINGTON BLVD.
LOS ANGELES, CA 90021