



JOB NO.: 24590
 EQUIPMENT NO.: PSA-VSL-00004, PSA-VSL-00005
 PURCHASE ORDER NO.: 24590-CM-POA-MCCA-00001
 REVISION NO.:
 SELLER'S TITLE: ATLAS COPCO COMPRESSORS
 SELLER'S ORDER NO.: M9-41113/22/3/4
 EQUIPMENT SERVICE: PLANT SERVICE AIR PACKAGE
 END USER: DEPARTMENT OF ENERGY
 PROJECT TITLE: RIVER PROTECTION PROJECT-
 WASTE TREATMENT PLANT
 PROJECT LOCATION: RICHLAND, WASHINGTON

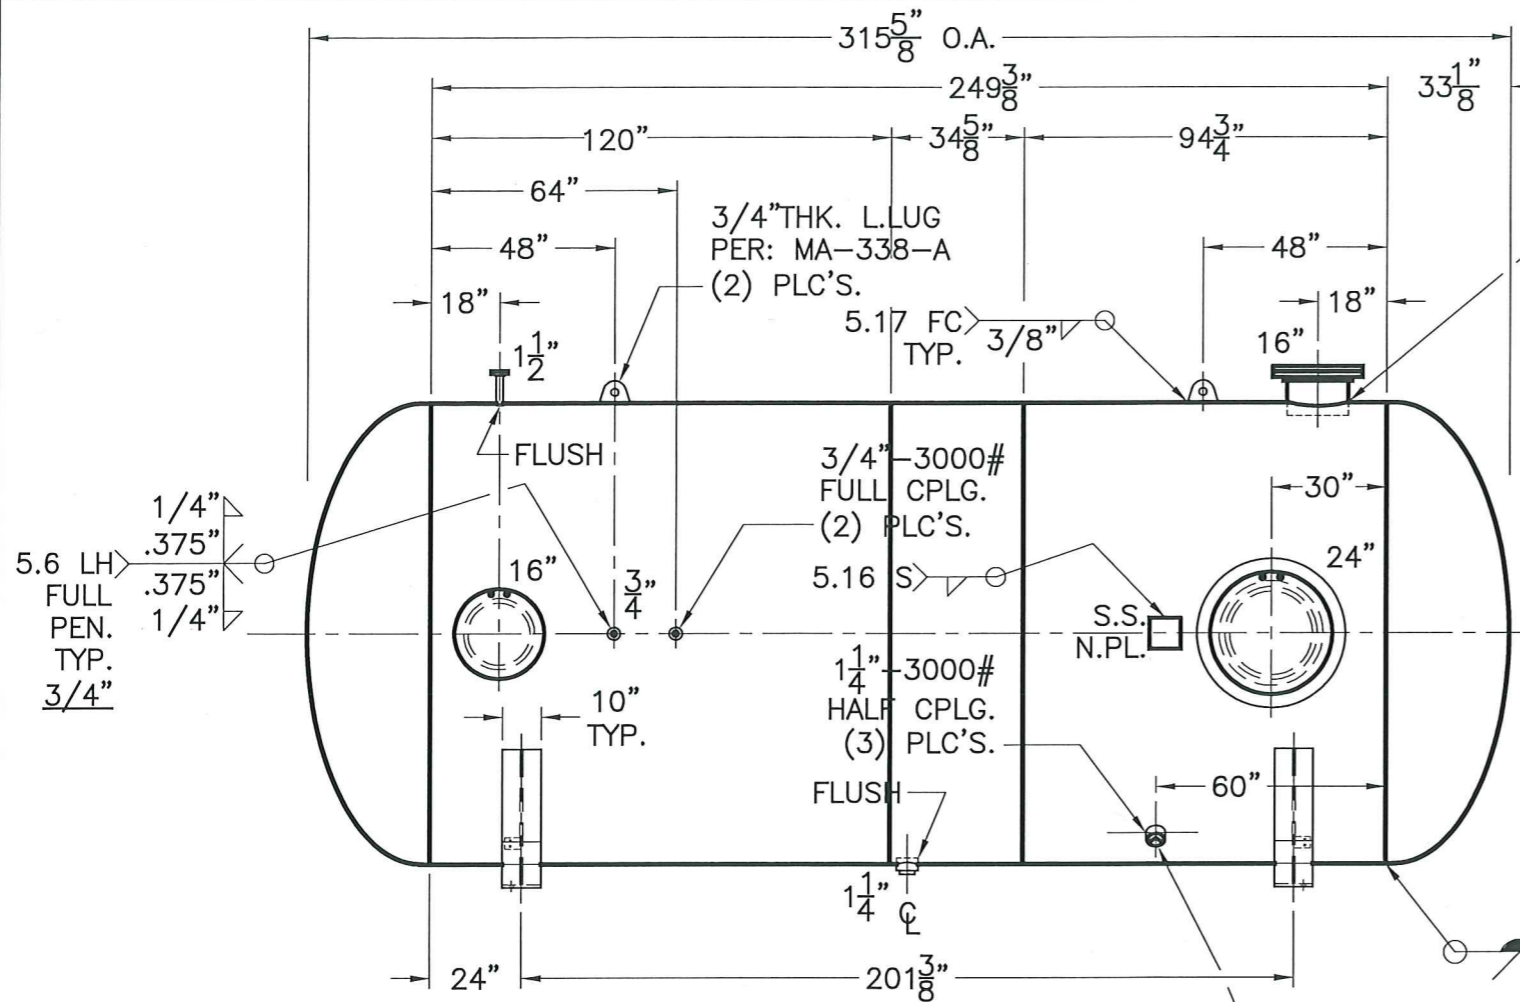

- NOTE: 1) HYDRO @ 215 PSIG. MIN.
 2) ALL FLANGES COVERED WITH BLIND FLANGE.
 3) ALL PADS SHALL HAVE 1/8" NPT WEEP HOLE.
 4) ONE HOUR HYDROSTATIC TEST.
 5) U.T. ALL NOZZLES & LIFT LUGS.
 6) PLUG ALL COUPLINGS.

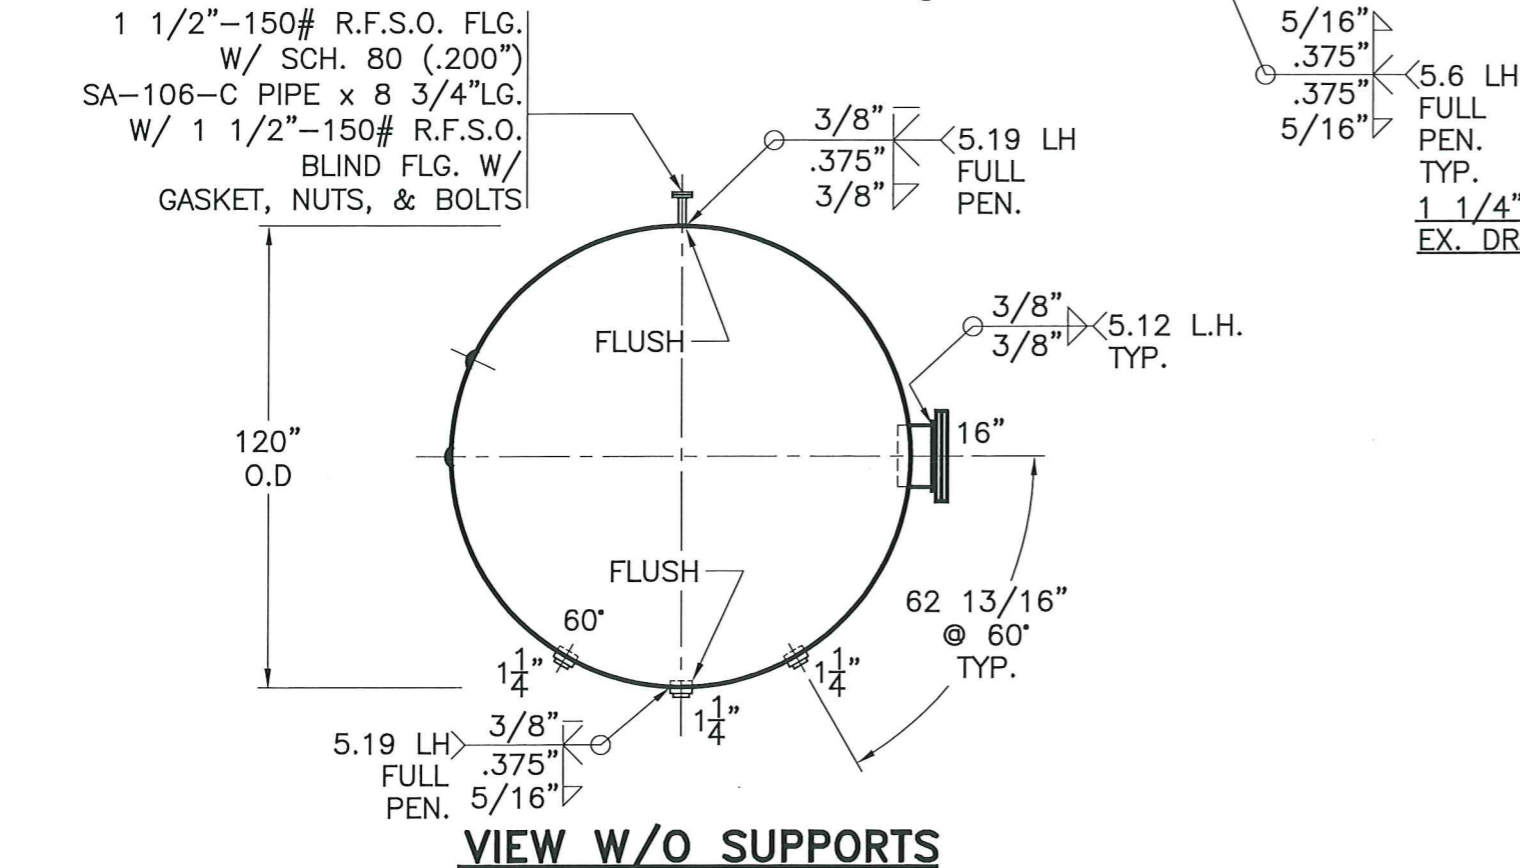

VIEW W/O SUPPORTS

HEADS	.750" SA-516-70 2:1 S.E. (.668" MIN.)
SHELL	.750" SA-516-70 END COURSES
	.875" SA-516-70 CENTER COURSE
	.040" C.A. ON ENTIRE VESSEL
M.A.W.P.	165 PSIG. @ 200 °F
M.D.M.T.	-20 °F @ 165 PSIG.
ASME. SECTION VIII DIV. 1, 2001 ADD 2002	
X-RAY: RT-4 SPOT L.S. & HDS. G.S.	
GALLONS:	14000
WT.	31607 LBS.
SERIAL NO.	
N.B.	

AH-048-B	REV. 3-30-05
	DATE: 9-16-03
FOR: HORIZ. AIR TANK	
INSIDE: UNPAINTED	
OUTSIDE: PRIMER SERIES 69 HI-BUILD	
FINISH SERIES 74 ENDURA-SHIELD GRAY	
BY: E.S. / BILL	SCALE: 1/4" = 12"
ROY E. HANSON JR. MFG.	
LOS ANGELES, CA 90011	