JOB No.	
DATE:	

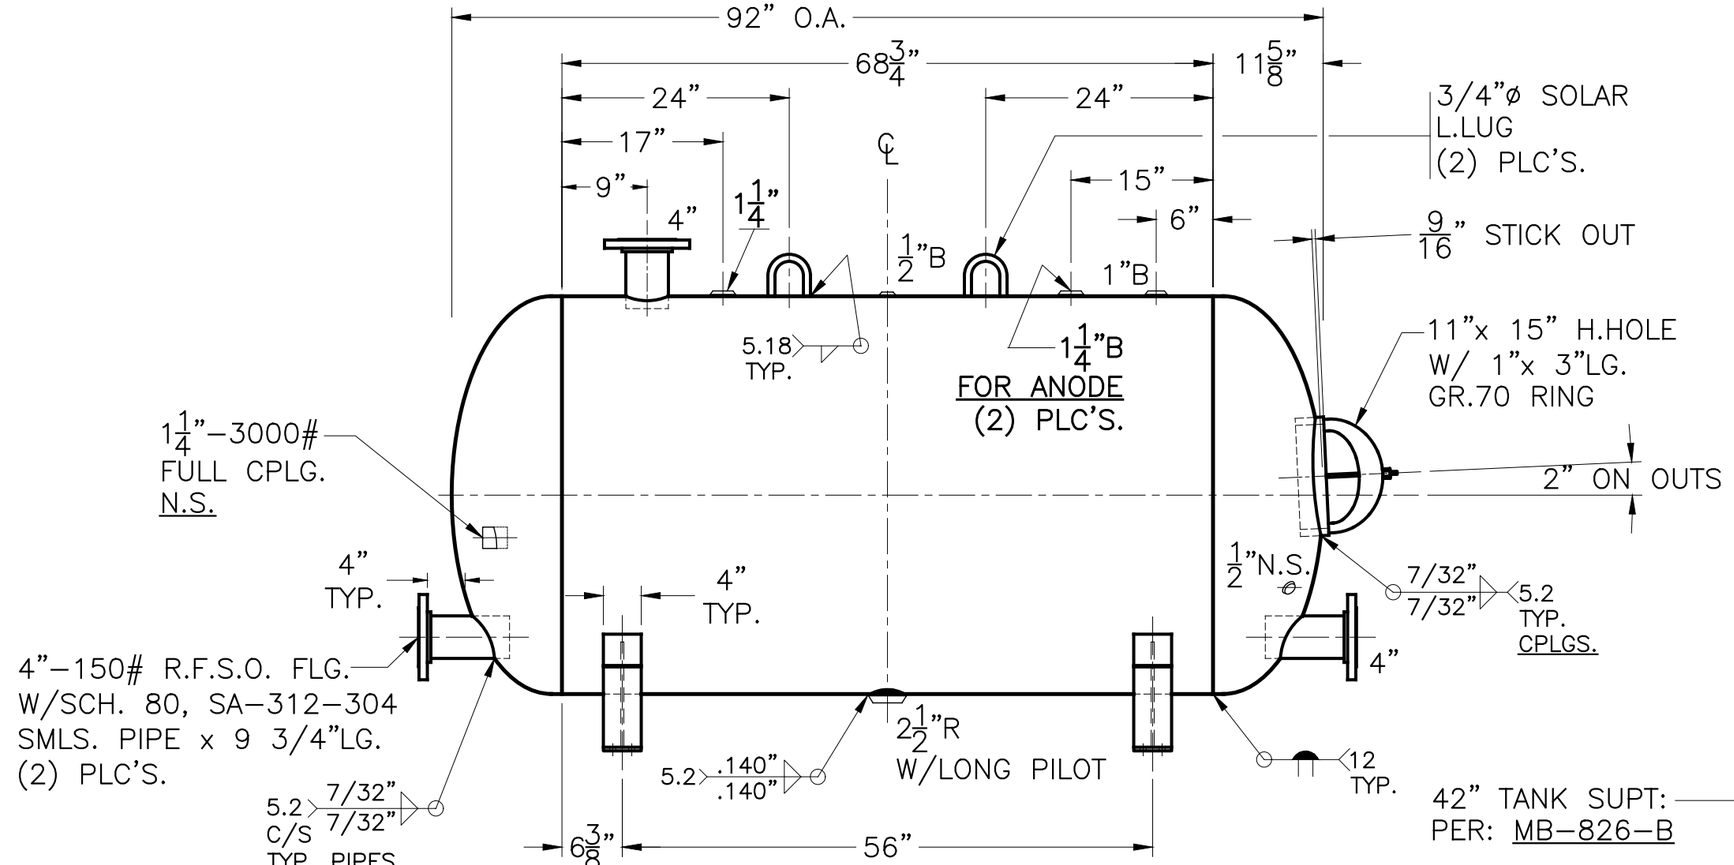

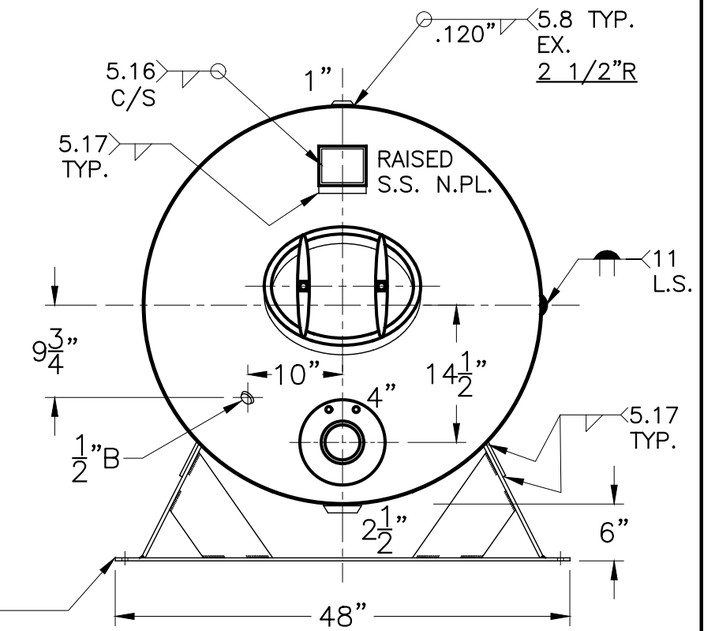

42" TANK SUPT:
PER: MB–826–B

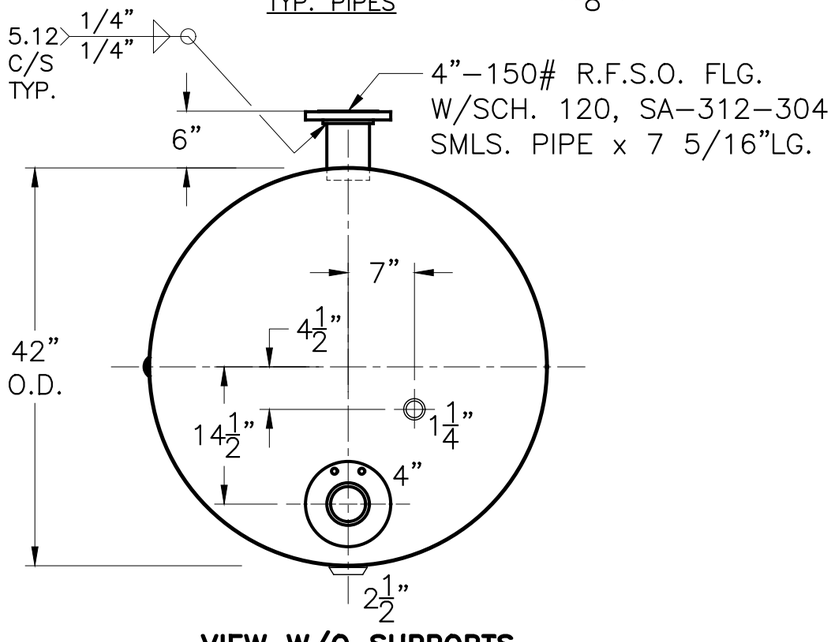

VIEW W/O SUPPORTS

4) ALL PIPES SA–312–304 SMLS.
3) SHELL: 3–11–09 PROOF TEST.
2) HYDRO @ 240 PSIG. MIN.
NOTE: 1) INSTALL (2) 1 5/16"x 36"LG. RIGID MAG. ANODES.

SHELL / HEADS	
	.205" SA–414–G 2:1 S.E.
	JOGGLE
	.175" SA–414–G

M.A.W.P.	160 PSIG. @ 210 °F
ASME SECTION Ⅷ	2023
X–RAY:	RT–NO / H.L.W.
GALLONS:	499 WT. 1060 LBS.
SERIAL NO.	
N.B.	

WP–681–B	REV. 4–29–24
	DATE: 6–5–18
FOR:	HANSON STANDARD
	HORIZ. HOT WATER TANK
	SURFACE AREA = 91.4 SQ. FT.
INSIDE:	GLASS LINED
	(5 MILS MIN.)
OUTSIDE:	S. BLAST AND PRIME
BY: J.G.	SCALE: 3/4"=12"

ROY E. HANSON JR. MFG.
LOS ANGELES, CA 90021